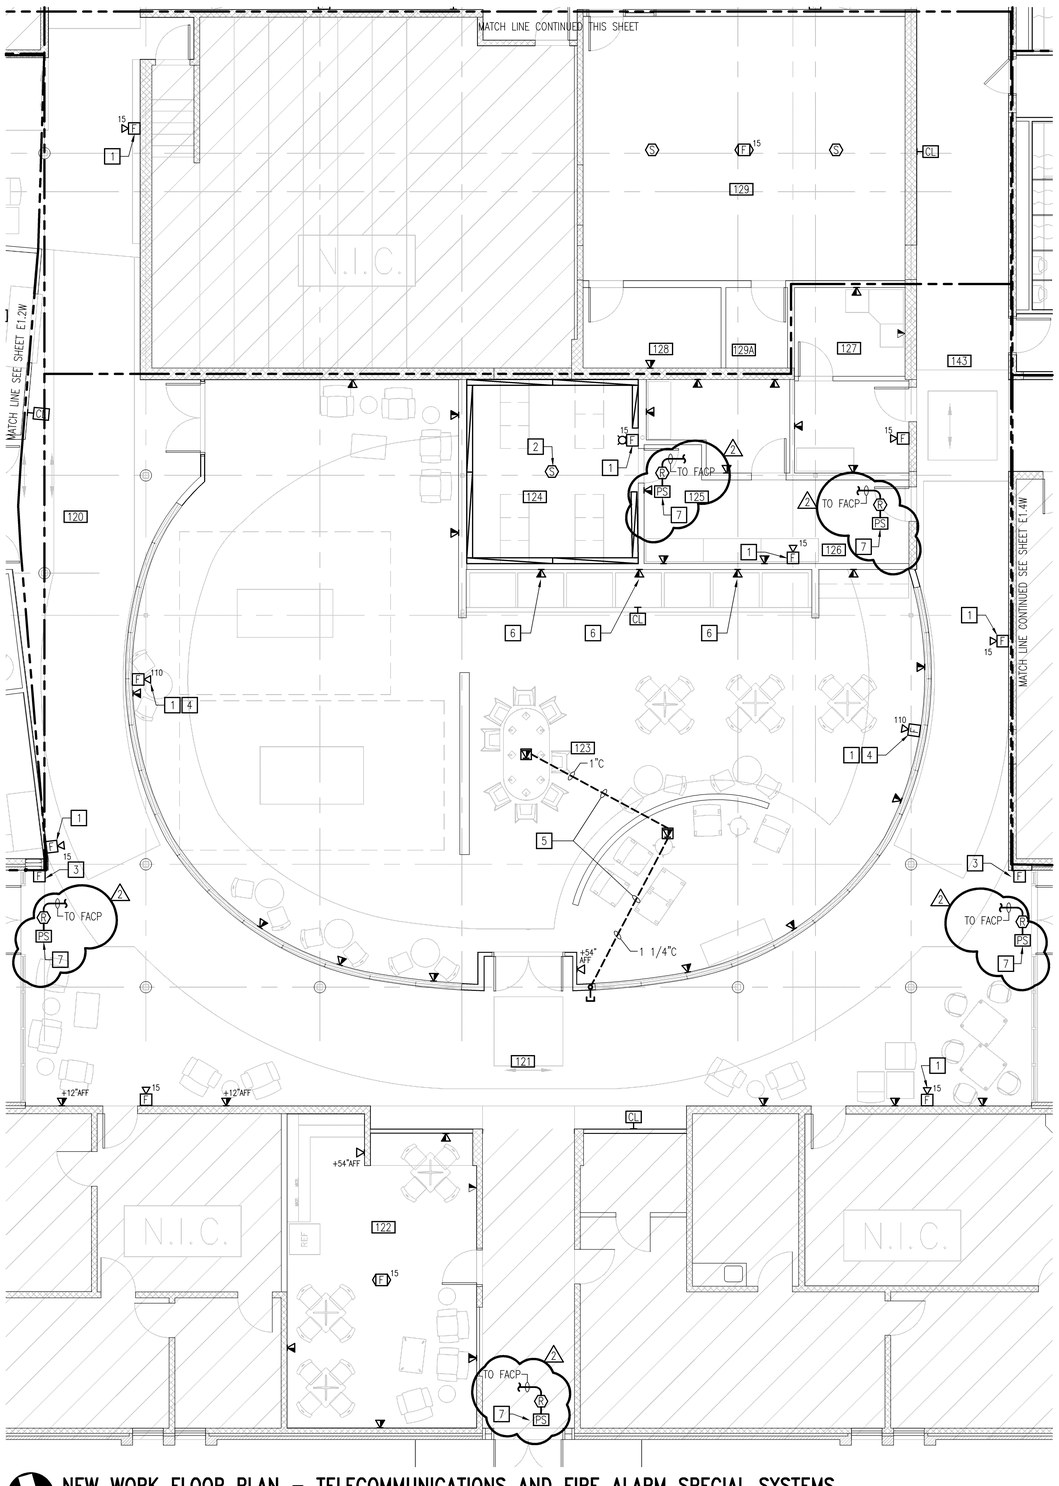

NEW WORK FLOOR PLAN – TELECOMMUNICATIONS AND FIRE ALARM SPECIAL SYSTEMS

SCALE: 3/16" = 1'-0"

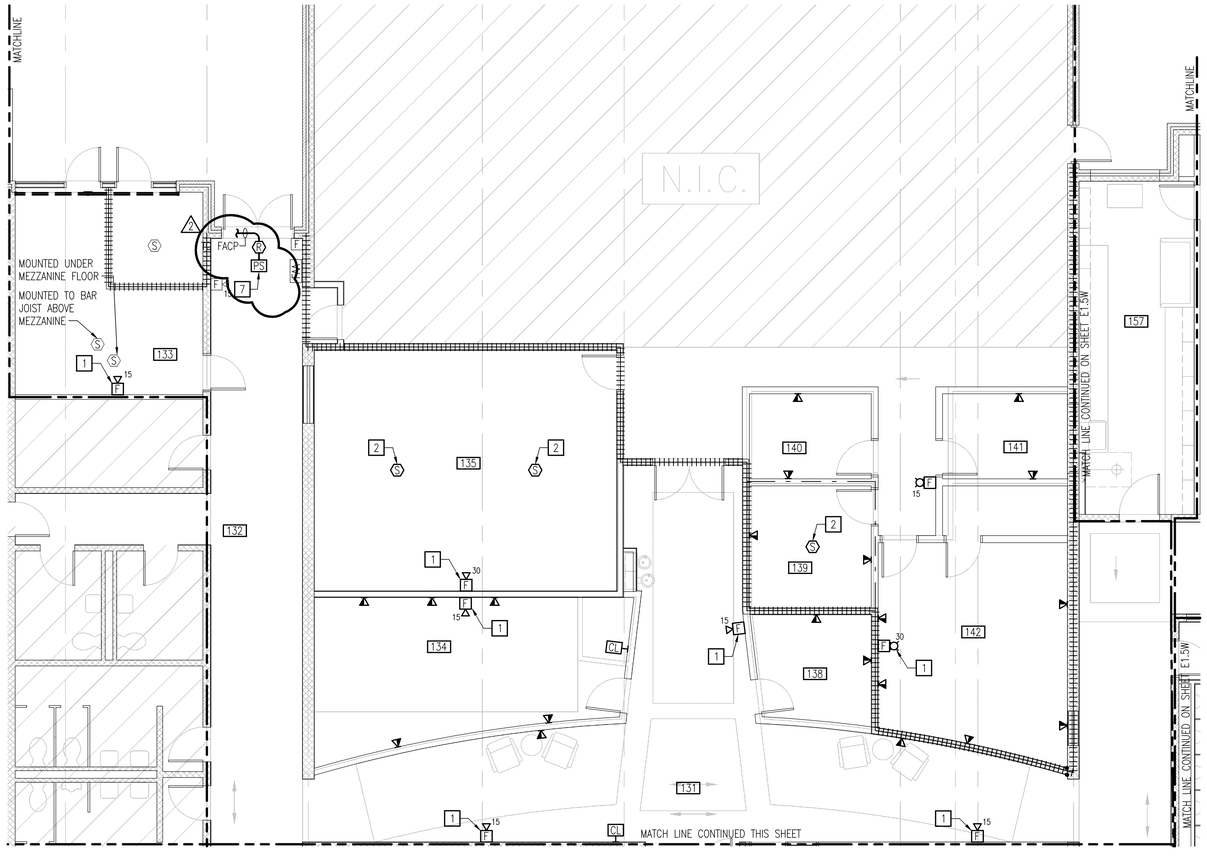

NOTES THIS SHEET

1. REINSTALL FIRE ALARM SYSTEM NOTIFICATION APPLIANCE SAVED DURING DEMOLITION PHASE.
2. REINSTALL FIRE ALARM SYSTEM CEILING MOUNTED SMOKE DETECTOR SAVED DURING DEMOLITION PHASE.
3. REINSTALL FIRE ALARM SYSTEM MANUAL PULL STATION SAVED DURING DEMOLITION PHASE.
4. SEE FIRE ALARM DEVICE MOUNTING DETAIL, SHEET E4.4.
5. SAW CUT, REMOVE AND PATCH CONCRETE FLOOR AS REQUIRED TO PERFORM WORK INDICATED. PATCH FLOOR TO MATCH ADJACENT EXISTING CONDITIONS.
6. FOR FUTURE USE. STUB EC TO ROOM 124. PROVIDE PULLSTRING AND BUSHED ENDS. PROVIDE BLANK COVER PLATE.
7. UPON SIGNAL FROM THE FIRE ALARM CONTROL PANEL, THE FIRE ALARM SYSTEM ADDRESSABLE RELAY MODULE SHALL RELEASE DOOR LOCK POWER SUPPLY. COORDINATE WITH OWNER DOOR ACCESS CONTROL SUPPLIER AND DOOR HARDWARE SUPPLIER FOR EXACT LOCATION AND REQUIREMENTS PRIOR TO INSTALLATION.

SECTION 1 ROOM SCHEDULE

120	CORRIDOR
121	CORRIDOR
122	FACULTY LOUNGE
123	STUDENT LOUNGE
124	SERVERS
125	TECH
125A	OFFICE
126	RECORDING
127	OFFICE
128	OFFICE
129	BOOKSTORE
129A	CLOSET
130	EXISTING LECTURE HALL

SECTION 2 ROOM SCHEDULE

127	OFFICE
128	OFFICE
129	BOOKSTORE
129A	CLOSET
130	EXISTING LECTURE HALL
131	CORRIDOR
132	CORRIDOR
133	ELECTRIC
134	TUTORING LAB
135	CHILDREN'S LIBRARY
136	–
137	EXISTING LIBRARY
138	OFFICE
139	STORAGE
140	HUDDLE
141	OFFICE
142	WORKROOM
143	CORRIDOR



KEYPLAN

NO SCALE

PACE COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA • 757-499-7229

GRAPHIC SCALES

3/16" = 1'-0" 0' 5' 10' 20'

nbj ARCHITECTURE
A Perkins+Will Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

WARSAW CAMPUS
NEW WORK FLOOR PLAN
TELECOMMUNICATIONS AND FIRE ALARM SPECIAL SYSTEMS

Date: MARCH 3, 2010

REVISIONS	
NO.	DATE
2	MARCH 3, 2010

COMMONWEALTH OF VIRGINIA
JAMES S. BEDOIS
Lic. No. 032929
PROFESSIONAL ENGINEER
3.3.10

Sheet
E3.3W

File Number
XX